


DESIGN		/	/
DRAFT		/	/
CHECKED		/	/

FIELD BOOK NO.	
PROFILE	ALIGNMENT


SURVEY		/	/
DRAWN		/	/
CHECKED		/	/

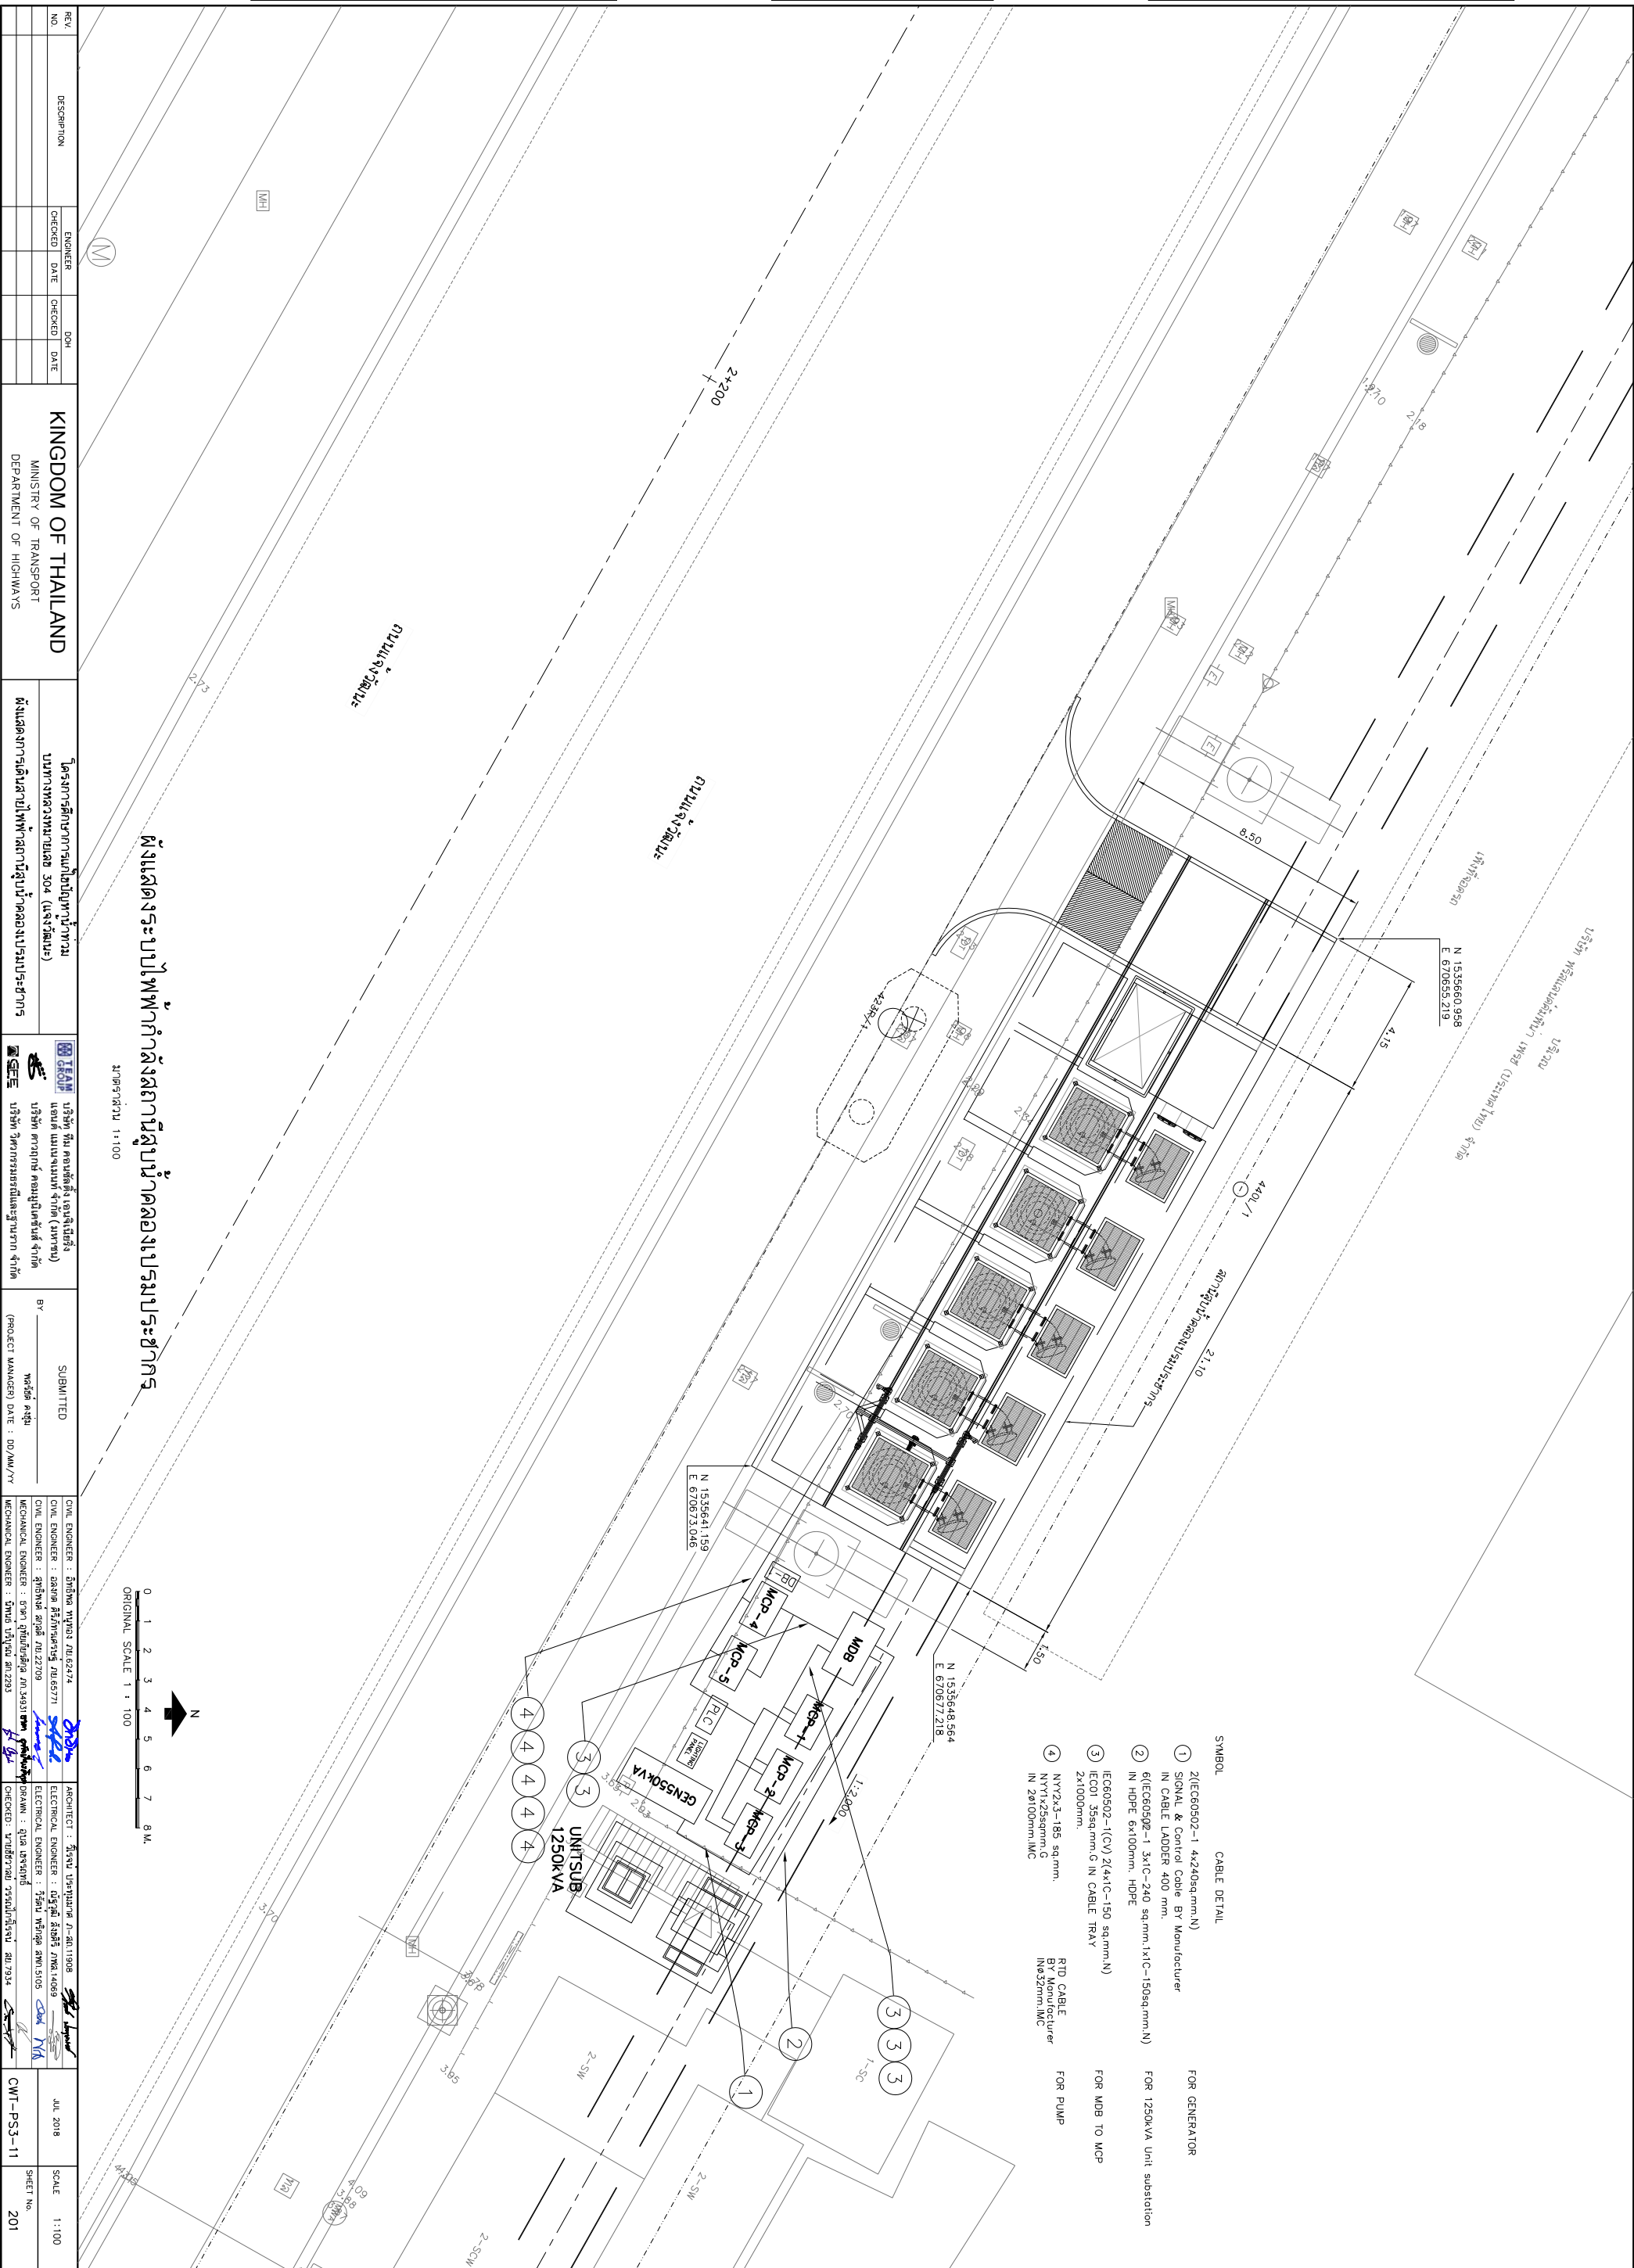

- SYMBOL CABLE DETAIL**
- | | |
|--|---|
| ① 2(IEC60502-1 4x240sq.mm.N)
IN CABLE LADDER 400 mm. | FOR GENERATOR |
| ② 6(IEC60502-1 3x1C-240 sq.mm.1x1C-150sq.mm.N)
IN HDPE 6x100mm. HDPE | FOR 1250KVA Unit substation |
| ③ IEC60502-1(CV) 2(4x1C-150 sq.mm.N)
IEC01 35sq.mm.G IN CABLE TRAY
2x1000mm. | FOR MDB TO MCP |
| ④ NYW2-3-195 sq.mm.
NY11 150sq.mm.I/C
IN 25100mm.I/C | RTD CABLE
BY Manufacturer
IN 52mm.I/C
FOR PUMP |

ผังแสดงระบบไฟฟ้ากำลังสถานีสูบน้ำคลองบางพระประชากร

มาตราส่วน 1:100

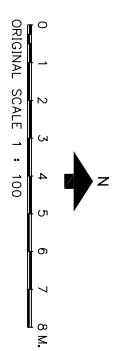

REV. NO.	DESCRIPTION	ENGINEER	DATE	DOH	DATE

KINGDOM OF THAILAND
 MINISTRY OF TRANSPORT
 DEPARTMENT OF HIGHWAYS

โครงการศึกษาการแก้ไขปัญหาน้ำท่วม
 ในทางหลวงหมายเลข 304 (แจ้งวัฒนะ)
 ฝั่งแสดงจากระบบไฟฟ้ากำลังสถานีสูบน้ำคลองบางพระประชากร

TEAM
 บริษัท ทีม คอนซัลติ้ง เঞ্জินีริ่ง
 แอนด์ แมเนจเม้นท์ จำกัด (มหาชน)
 บริษัท ศาคราญ คอมพิวเตอร์ จำกัด
 บริษัท วิศวกรรมโยธาและฐานราก จำกัด

SUBMITTED
 BY:
 PROJECT MANAGER DATE: DD/MM/YY

CIVIL ENGINEER : อธิวัฒน์ พญาภู่ 78.62474
 CIVIL ENGINEER : อธิวัฒน์ พญาภู่ 78.62474
 MECHANICAL ENGINEER : อธิวัฒน์ พญาภู่ 78.62474
 ARCHITECT : อธิวัฒน์ พญาภู่ 78.62474
 ELECTRICAL ENGINEER : อธิวัฒน์ พญาภู่ 78.62474
 DRAWN : อธิวัฒน์ พญาภู่ 78.62474
 CHECKED : อธิวัฒน์ พญาภู่ 78.62474

JUL 2018
 SCALE 1:100
 SHEET No. 201